



香港標準及檢定中心
Hong Kong Standards and Testing Centre

Date : 2002-09-04

TEST REPORT

Page 1 of 2

NO: HC116479

APPLICANT: (Code: MAF002)

Many Folk Enterprises Limited
Flat F 13/F Golden Plaza
745-7 Nathan Rd
Kln

Attn: Mr Raymond Fung

DESCRIPTION OF SAMPLE(S):

One submitted sample said to be 20mm Solid Coupler (Hot-Dip Galvanized).
Item No. : HNC140
Brand Name :



SAMPLE(S) RECEIVED DATE:

2002-08-19

TESTED DATE:

2002-08-28

INVESTIGATION(S) REQUESTED:

Test for resistance to corrosion – IEC 614-1 : 1994 : Clause 13.4.5 /
BS 4568 : Part 2 : 1970 (1988) Heavy Protection


Anne Chuah, CEE
For Chief Executive



Conditions in issuance of Test Report

1. This Report is issued in confidence to the client and it will be strictly treated as such by the Hong Kong Standards and Testing Centre Ltd. It may not be reproduced either in its entirety or in part and it may not be used for advertising. The client to whom the Report is issued may, however, show or send it, or a certified copy thereof prepared by the Hong Kong Standards and Testing Centre Ltd. to his customer, supplier or other persons directly concerned. The Hong Kong Standards and Testing Centre Ltd. will not, without the consent of the client, enter into any discussion of correspondence with any third party concerning the contents of the Report. 2. The report refers only to the sample tested and does not apply to the bulk, unless the sampling has been carried out by the Hong Kong Standards and Testing Centre Ltd. and is stated as such in the Report. 3. In the event of the improper use of the report, the Hong Kong Standards and Testing Centre Ltd. reserves the rights to withdraw it, and to adopt any other remedies which may be appropriate. 4. Samples submitted for testing are accepted on the understanding that the Report issued cannot form the basis of, or be the instrument for, any legal action against the Hong Kong Standards and Testing Centre Ltd. 5. The Hong Kong Standards and Testing Centre Ltd. will not be liable for or accept responsibility for any loss or damage howsoever arising from the use of information contained in any of its Reports or in any communication whatsoever about its said tests or investigations. 6. Applicants wishing to use the Report in court proceedings or arbitration shall inform the Hong Kong Standards and Testing Centre Ltd. to their effect prior to submitting the sample for testing.

香港新界大埔工業邨大宏街10號
10 Dai Wang Street,
Taipo Industrial Estate,
N. T., Hong Kong
Tel : (852) 2666 1888
Fax : (852) 2664 4353
Homepage: www.hkstc.com
E-mail: hkstc@hkstc.com



香港標準及檢定中心
Hong Kong Standards and Testing Centre

Date : 2002-09-04

Page 2 of 2

NO: HC116479

METHOD(S) USED:

Ref. IEC 614-1 : 1994 Clause 13.4.5 and BS 4568 : Part 2 : 1970 (1988) :
Appendix A.3.3


TEST RESULT(S):

Number of specimen tested:	3 pieces
Number of specimen passed:	3 pieces
Number of specimen failed:	0 piece

SUMMARY

1. The submitted 20mm Solid Coupler (Hot-Dip Galvanized) complied with Clause 13.4.5 of IEC 614-1 : 1994 and BS 4568 : Part 2 : 1970 (1988) for Heavy Protection.
2. It also complied with the General Specification for Electrical Installation in Government Buildings of The Hong Kong Special Administrative Region (1998 Edition).

PHOTO OF SAMPLE:

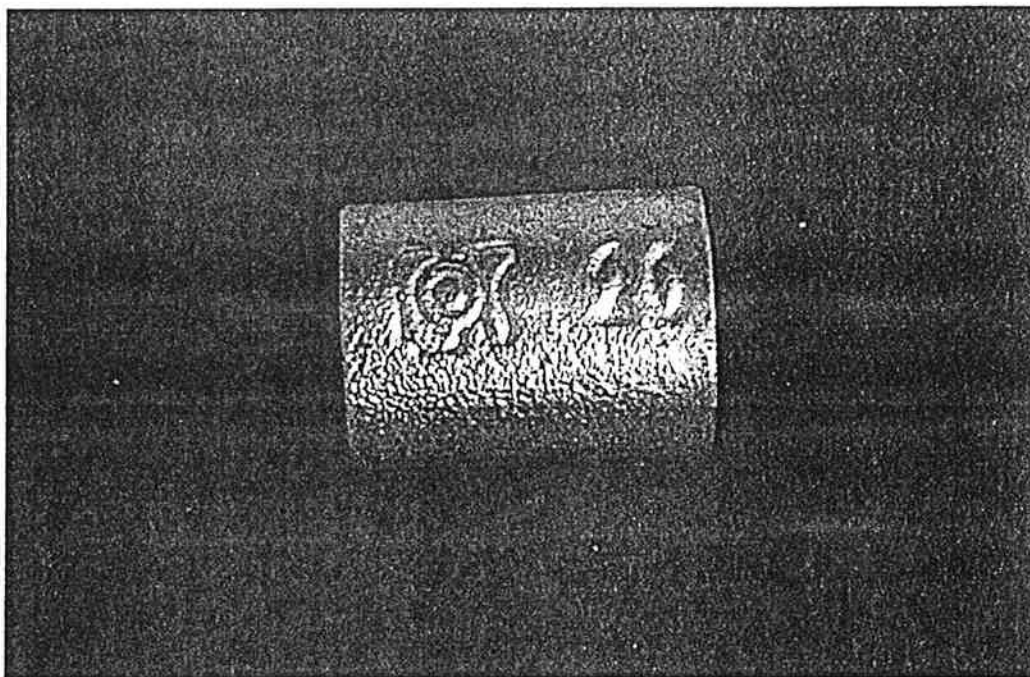

***** End of Document *****

Conditions in issuance of Test Report

1. This Report is issued in confidence to the client and it will be strictly treated as such by the Hong Kong Standards and Testing Centre Ltd. It may not be reproduced either in its entirety or in part and it may not be used for advertising. The client to whom the Report is issued may, however, show or send it, or a certified copy thereof prepared by the Hong Kong Standards and Testing Centre Ltd. to his customer, supplier or other persons directly concerned. The Hong Kong Standards and Testing Centre Ltd. will not, without the consent of the client, enter into any discussion of correspondence with any third party concerning the contents of the Report. 2. The report refers only to the sample tested and does not apply to the bulk, unless the sampling has been carried out by the Hong Kong Standards and Testing Centre Ltd. and is stated as such in the Report. 3. In the event of the improper use of the report, the Hong Kong Standards and Testing Centre Ltd. reserves the rights to withdraw it, and to adopt any other remedies which may be appropriate. 4. Samples submitted for testing are accepted on the understanding that the Report issued cannot form the basis of, or be the instrument for, any legal action against the Hong Kong Standards and Testing Centre Ltd. 5. The Hong Kong Standards and Testing Centre Ltd. will not be liable for or accept responsibility for any loss or damage whatsoever arising from the use of information contained in any of its Reports or in any communication whatsoever about its tests or investigations. 6. The client signing the Report is deemed to accept the Report and its contents in full and to release the Hong Kong Standards and Testing Centre Ltd. from all liability in connection with the Report.

香港新界大埔工業邨大宏街10號
10 Dai Wang Street,
Taipo Industrial Estate,
N. T., Hong Kong
Tel : (852) 2666 1888
Fax : (852) 2664 4353
Homepage: www.hkstdc.com



香港標準及檢定中心
Hong Kong Standards and Testing Centre

Date : 2002-09-04

TEST REPORT

Page 1 of 2

NO: HC116480

APPLICANT: (Code: MAF002)

Many Folk Enterprises Limited
Flat F 13/F Golden Plaza
745-7 Nathan Rd
Kln

Attn: Mr Raymond Fung

DESCRIPTION OF SAMPLE(S):

One submitted sample said to be 25mm Solid Coupler (Hot-Dip Galvanized).
Item No. : HNC141
Brand Name :



SAMPLE(S) RECEIVED DATE:

2002-08-19

TESTED DATE:

2002-08-28

INVESTIGATION(S) REQUESTED:

Test for resistance to corrosion – IEC 614-1 : 1994 : Clause 13.4.5 /
BS 4568 : Part 2 : 1970 (1988) Heavy Protection



Anne Chuah, CFE
For Chief Executive

Conditions in issuance of Test Report

1. This Report is issued in confidence to the client and it will be strictly treated as such by the Hong Kong Standards and Testing Centre Ltd. It may not be reproduced either in its entirety or in part and it may not be used for advertising. The client to whom the Report is issued may, however, show or send it, or a certified copy thereof prepared by the Hong Kong Standards and Testing Centre Ltd. to his customer, supplier or other persons directly concerned. The Hong Kong Standards and Testing Centre Ltd. will not, without the consent of the client, enter into any discussion of correspondence with any third party concerning the contents of the Report. 2. The report refers only to the sample tested and does not apply to the bulk, unless the sampling has been carried out by the Hong Kong Standards and Testing Centre Ltd. and is stated as such in the Report. 3. In the event of the improper use of the report, the Hong Kong Standards and Testing Centre Ltd. reserves the rights to withdraw it, and to adopt any other remedies which may be appropriate. 4. Samples submitted for testing are accepted on the understanding that the Report issued cannot form the basis of, or be the instrument for, any legal action against the Hong Kong Standards and Testing Centre Ltd. 5. The Hong Kong Standards and Testing Centre Ltd. will not be liable for or accept responsibility for any loss or damage, however caused, arising from the use of the Report.

香港新界大埔工業邨大宏街10號
10 Dai Wang Street,
Taipo Industrial Estate,
N. T., Hong Kong
Tel : (852) 2666 1888
Fax : (852) 2664 4353



香港標準及檢定中心
Hong Kong Standards and Testing Centre

Date : 2002-09-04

Page 2 of 2

NO: HC116480

METHOD(S) USED:

Ref. IEC 614-1 : 1994 Clause 13.4.5 and BS 4568 : Part 2 : 1970 (1988) :
Appendix A.3.3


TEST RESULT(S):

Number of specimen tested:	3 pieces
Number of specimen passed:	3 pieces
Number of specimen failed:	0 piece

SUMMARY

1. The submitted 25mm Solid Coupler (Hot-Dip Galvanized) complied with Clause 13.4.5 of IEC 614-1 : 1994 and BS 4568 : Part 2 : 1970 (1988) for Heavy Protection.
2. It also complied with the General Specification for Electrical Installation in Government Buildings of The Hong Kong Special Administrative Region (1998 Edition).

PHOTO OF SAMPLE:

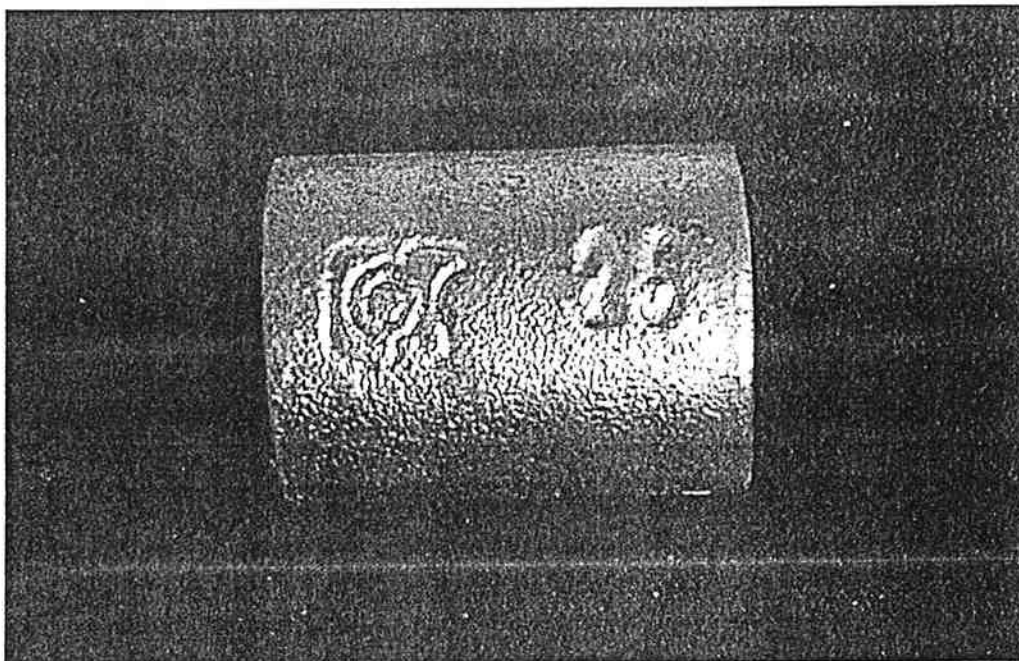

***** End of Document *****

Conditions in issuance of Test Report

1. This Report is issued in confidence to the client and it will be strictly treated as such by the Hong Kong Standards and Testing Centre Ltd. It may not be reproduced either in its entirety or in part and it may not be used for advertising. The client to whom the Report is issued may, however, show or send it, or a certified copy thereof prepared by the Hong Kong Standards and Testing Centre Ltd. to his customer, supplier or other persons directly concerned. The Hong Kong Standards and Testing Centre Ltd. will not, without the consent of the client, enter into any discussion of correspondence with any third party concerning the contents of the Report. 2. The report refers only to the sample tested and does not apply to the bulk, unless the sampling has been carried out by the Hong Kong Standards and Testing Centre Ltd. and is stated as such in the Report. 3. In the event of the improper use of the report, the Hong Kong Standards and Testing Centre Ltd. reserves the rights to withdraw and is not liable for any other remedies which may be appropriate. 4. Samples submitted for testing are accepted on the understanding that the Report issued cannot form the basis of, or be the instrument for, any legal action against the Hong Kong Standards and Testing Centre Ltd. The Hong Kong Standards and Testing Centre Ltd. will not be liable for or accept responsibility for any loss or damage howsoever arising from the use of information contained in any of its Reports or in any communication whatsoever about its said tests or investigations. 5. Applicants wishing to use the Report in court proceedings or arbitration shall inform the Hong

香港新界大埔工業邨大宏街10號
10 Dai Wang Street,
Taipo Industrial Estate,
N. T., Hong Kong
Tel : (852) 2666 1888
Fax : (852) 2664 4353
Homepage: www.hkstdc.com
E-mail: hkstdc@hkstdc.com



香港標準及檢定中心
Hong Kong Standards and Testing Centre

Date : 2002-09-04

TEST REPORT

Page 1 of 2

NO: HC116481

APPLICANT: (Code: MAF002)

Many Folk Enterprises Limited
Flat F 13/F Golden Plaza
745-7 Nathan Rd
Kln

Attn: Mr Raymond Fung

DESCRIPTION OF SAMPLE(S):

One submitted sample said to be 32mm Solid Coupler (Hot-Dip Galvanized).
Item No. : HNC142
Brand Name :



SAMPLE(S) RECEIVED DATE:

2002-08-19

TESTED DATE:

2002-08-28

INVESTIGATION(S) REQUESTED:

Test for resistance to corrosion – IEC 614-1 : 1994 : Clause 13.4.5 /
BS 4568 : Part 2 : 1970 (1988) Heavy Protection



Anne Chuah, CBD
For Chief Executive

Conditions in issuance of Test Report

1. This Report is issued in confidence to the client and it will be strictly treated as such by the Hong Kong Standards and Testing Centre Ltd. It may not be reproduced either in its entirety or in part and it may not be used for advertising. The client to whom the Report is issued may, however, show or send it, or a certified copy thereof prepared by the Hong Kong Standards and Testing Centre Ltd. to his customer, supplier or other persons directly concerned. The Hong Kong Standards and Testing Centre Ltd. will not, without the consent of the client, enter into any discussion of correspondence with any third party concerning the contents of the Report. 2. The report refers only to the sample tested and does not apply to the bulk, unless the sampling has been carried out by the Hong Kong Standards and Testing Centre Ltd. and is stated as such in the Report. 3. In the event of the improper use of the report, the Hong Kong Standards and Testing Centre Ltd. reserves the rights to withdraw it, and to adopt any other remedies which may be appropriate. 4. Samples submitted for testing are accepted on the understanding that the Report issued cannot form the basis of, or be the instrument for, any legal action against the Hong Kong Standards and Testing Centre Ltd. 5. The Hong Kong Standards and Testing Centre Ltd. will not be liable for or accept responsibility for any loss or damage howsoever arising from the use of information contained in any of its Reports or in any

香港新界大埔工業邨大宏街10號
10 Dai Wang Street,
Taipo Industrial Estate,
N. T., Hong Kong
Tel : (852) 2666 1888
Fax : (852) 2664 4353



香 港 標 準 及 檢 定 中 心

Hong Kong Standards and Testing Centre

Date : 2002-09-04

Page 2 of 2

NO: HC116481

METHOD(S) USED:

Ref. IEC 614-1 : 1994 Clause 13.4.5 and BS 4568 : Part 2 : 1970 (1988) :
Appendix A.3.3


TEST RESULT(S):

Number of specimen tested:	3 pieces
Number of specimen passed:	3 pieces
Number of specimen failed:	0 piece

SUMMARY

1. The submitted 32mm Solid Coupler (Hot-Dip Galvanized) complied with Clause 13.4.5 of IEC 614-1 : 1994 and BS 4568 : Part 2 : 1970 (1988) for Heavy Protection.
2. It also complied with the General Specification for Electrical Installation in Government Buildings of The Hong Kong Special Administrative Region (1998 Edition).

PHOTO OF SAMPLE:

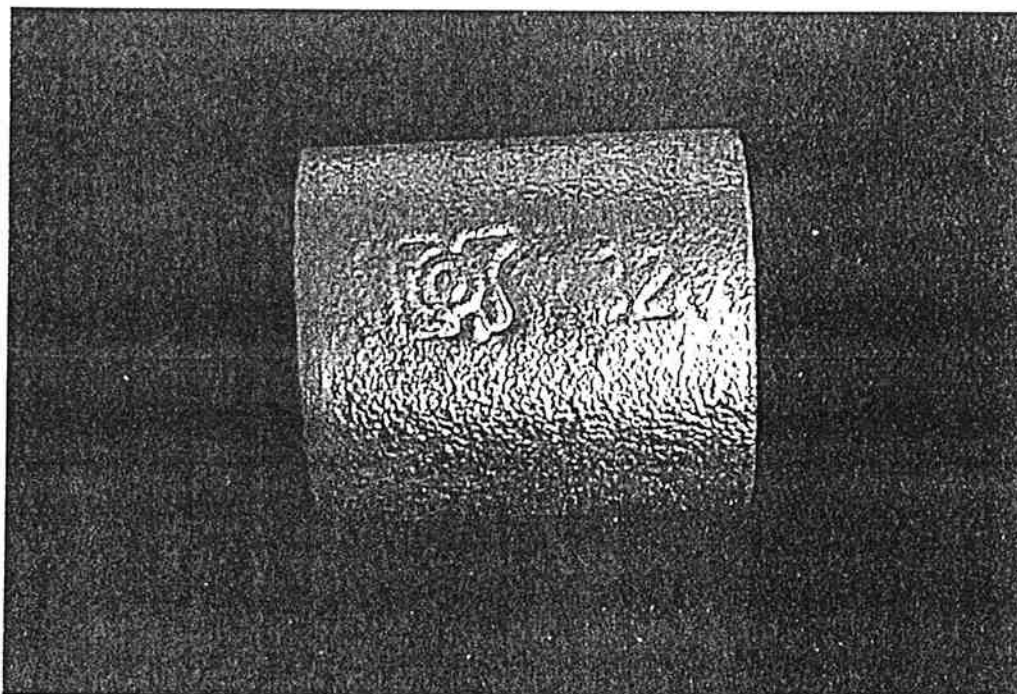

***** End of Document *****

Conditions in issuance of Test Report

1. This Report is issued in confidence to the client and it will be strictly treated as such by the Hong Kong Standards and Testing Centre Ltd. It may not be reproduced either in its entirety or in part and it may not be used for advertising. The client to whom the Report is issued may, however, show or send it, or a certified copy thereof prepared by the Hong Kong Standards and Testing Centre Ltd. to his customer, supplier or other persons directly concerned. The Hong Kong Standards and Testing Centre Ltd. will not, without the consent of the client, enter into any discussion of correspondence with any third party concerning the contents of the Report. 2. The report refers only to the sample tested and does not apply to the bulk, unless the sampling has been carried out by the Hong Kong Standards and Testing Centre Ltd. and is stated as such in the Report. 3. In the event of the improper use of the report, the Hong Kong Standards and Testing Centre Ltd. reserves the rights to withdraw it, and to adopt any other remedies which may be appropriate. 4. Samples submitted for testing are accepted on the understanding that the Report issued cannot form the basis of, or be the instrument for, any legal action against the Hong Kong Standards and Testing Centre Ltd. 5. The Hong Kong Standards and Testing Centre Ltd. will not be liable for or accept responsibility for any loss or damage whatsoever arising from the use of information contained in any of its Reports or in any communication whatsoever about its said tests or investigations. 6. Applicants wishing to use the Report in court proceedings or litigation shall inform the Hong

香港新界大埔工業邨大宏街10號
10 Dai Wang Street,
Taipo Industrial Estate,
N. T., Hong Kong
Tel : (852) 2666 1888
Fax : (852) 2664 4353
Homepage: www.hkstc.com



香港標準及檢定中心

Hong Kong Standards and Testing Centre

Date : 2002-09-04

TEST REPORT

Page 1 of 2

NO: HC116482

APPLICANT: (Code: MAF002)

Many Folk Enterprises Limited
Flat F 13/F Golden Plaza
745-7 Nathan Rd
Kln

Attn: Mr Raymond Fung

DESCRIPTION OF SAMPLE(S):

One submitted sample said to be 20mm Distance Saddle (Hot-Dip Galvanized).
Item No. : HNSP20
Brand Name :

SAMPLE(S) RECEIVED DATE:

2002-08-19

TESTED DATE:

2002-08-28

INVESTIGATION(S) REQUESTED:

Test for resistance to corrosion – IEC 614-1 : 1994 : Clause 13.4.5 /
BS 4568 : Part 2 : 1970 (1988) Heavy Protection



Am
Anne Chuah, CFD
For Chief Executive

Conditions in Issuance of Test Report

1. This Report is issued in confidence to the client and it will be strictly treated as such by the Hong Kong Standards and Testing Centre Ltd. It may not be reproduced either in its entirety or in part and it may not be used for advertising. The client to whom the Report is issued may, however, show or send it, or a certified copy thereof prepared by the Hong Kong Standards and Testing Centre Ltd. to his customer, supplier or other persons directly concerned. The Hong Kong Standards and Testing Centre Ltd. will not, without the consent of the client, enter into any discussion of correspondence with any third party concerning the contents of the Report. 2. The report refers only to the sample tested and does not apply to the bulk, unless the sampling has been carried out by the Hong Kong Standards and Testing Centre Ltd. and is stated as such in the Report. 3. In the event of the improper use of the report, the Hong Kong Standards and Testing Centre Ltd. reserves the rights to withdraw it, and to adopt any other remedies which may be appropriate. 4. Samples submitted for testing are accepted on the understanding that the Report issued cannot form the basis of, or be the instrument for, any legal action against the Hong Kong Standards and Testing Centre Ltd. 5. The Hong Kong Standards and Testing Centre Ltd. will not be liable for or accept responsibility for any loss or damage howsoever arising from the use of information contained in any of its Reports or in any communication whatsoever about its said tests or investigations. 6. Applicants wishing to use the Report in court proceedings or arbitration shall inform the Hong

香港新界大埔工業邨大宏街10號
10 Dai Wang Street,
Taipo Industrial Estate,
N. T., Hong Kong
Tel : (852) 2666 1888
Fax : (852) 2664 4353
Homepage: www.hkstdc.com



香港標準及檢定中心

Hong Kong Standards and Testing Centre

Date : 2002-09-04

Page 2 of 2

NO: HC116482

METHOD(S) USED:

Ref. IEC 614-1 : 1994 Clause 13.4.5 and BS 4568 : Part 2 : 1970 (1988) :
Appendix A.3.3


TEST RESULT(S):

Number of specimen tested:	3 pieces
Number of specimen passed:	3 pieces
Number of specimen failed:	0 piece

SUMMARY

1. The submitted 20mm Distance Saddle (Hot-Dip Galvanized) complied with Clause 13.4.5 of IEC 614-1 : 1994 and BS 4568 : Part 2 : 1970 (1988) for Heavy Protection.
2. It also complied with the General Specification for Electrical Installation in Government Buildings of The Hong Kong Special Administrative Region (1998 Edition).

PHOTO OF SAMPLE:

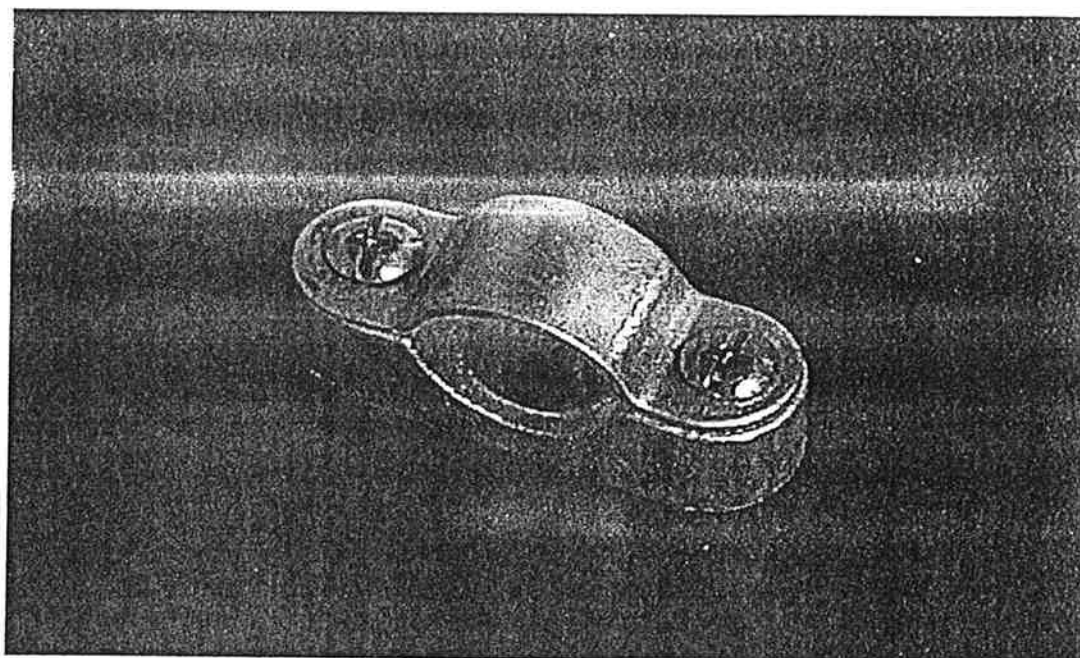

***** End of Document *****

Conditions in issuance of Test Report

1. This Report is issued in confidence to the client and it will be strictly treated as such by the Hong Kong Standards and Testing Centre Ltd. It may not be reproduced either in its entirety or in part and it may not be used for advertising. The Centre, which the Report is issued may, however, know or send it to a certified body (member) prepared by the Hong Kong Standards and Testing Centre Ltd. to his customer, supplier or other persons directly concerned. The Hong Kong Standards and Testing Centre Ltd. will not, without the consent of the client, enter into any discussion or correspondence with any third party concerning the contents of the Report. 2. The report refers only to the sample tested and does not apply to the bulk, unless the sampling has been carried out by the Hong Kong Standards and Testing Centre Ltd. and is stated as such in the Report. 3. In the event of the improper use of the report, the Hong Kong Standards and Testing Centre Ltd. reserves the rights to withdraw it and to adopt any other remedies, including, but not limited to, the suspension of its services. 4. Samples submitted for testing are accepted on the understanding that the Report, issued cannot be used to adopt any other remedies, including, but not limited to, the suspension of its services. 5. The Hong Kong Standards and Testing Centre Ltd. reserves the right to withdraw the Report, issued cannot be used to adopt any other remedies, including, but not limited to, the suspension of its services.

香港新界大埔工業邨大宏街10號
10 Dai Wang Street,
Taipo Industrial Estate,
N. T., Hong Kong
Tel : (852) 2666 1888
Fax : (852) 2666 1250



香港標準及檢定中心

Hong Kong Standards and Testing Centre

Date : 2002-09-04

TEST REPORT

Page 1 of 2

NO: HC116483

APPLICANT: (Code: MAF002)

Many Folk Enterprises Limited
Flat F 13/F Golden Plaza
745-7 Nathan Rd
Kln

Attn: Mr Raymond Fung

DESCRIPTION OF SAMPLE(S):

One submitted sample said to be 25mm Distance Saddle (Hot-Dip Galvanized).
Item No. : HNSP25
Brand Name :

SAMPLE(S) RECEIVED DATE:

2002-08-19

TESTED DATE:

2002-08-28

INVESTIGATION(S) REQUESTED:

Test for resistance to corrosion – IEC 614-1 : 1994 : Clause 13.4.5 /
BS 4568 : Part 2 : 1970 (1988) Heavy Protection



Anne Chuah, CFD
For Chief Executive

Conditions in issuance of Test Report

1. This Report is issued in confidence to the client and it will be strictly treated as such by the Hong Kong Standards and Testing Centre Ltd. It may not be reproduced either in its entirety or in part and it may not be used for advertising. The client to whom the Report is issued may, however, show or send it, or a certified copy thereof prepared by the Hong Kong Standards and Testing Centre Ltd. to his customer, supplier or other persons directly concerned. The Hong Kong Standards and Testing Centre Ltd. will not, without the consent of the client, enter into any discussion of correspondence with any third party concerning the contents of the Report. 2. The report refers only to the sample tested and does not apply to the bulk, unless the sampling has been carried out by the Hong Kong Standards and Testing Centre Ltd. and is stated as such in the Report. 3. In the event of the improper use of the report, the Hong Kong Standards and Testing Centre Ltd. reserves the rights to withdraw it, and to adopt any other remedies which may be appropriate. 4. Samples submitted for testing are accepted on the understanding that the Report issued cannot form the basis of, or be the instrument for, any legal action against the Hong Kong Standards and Testing Centre Ltd. 5. The Hong Kong Standards and Testing Centre Ltd. will not be liable for or accept responsibility for any loss or damage howsoever arising from the use of information contained in any of its Reports or in any other manner whatsoever.

Hong Kong Standards and Testing Centre Ltd. has no effect prior to submitting the sample for testing.

香港新界大埔工業邨大宏街10號
10 Dai Wang Street,
Taipo Industrial Estate,
N. T., Hong Kong
Tel : (852) 2666 1888
Fax : (852) 2664 4353
Homepage: www.hkstdc.com
E-mail: hkstdc@hkstdc.com



香港標準及檢定中心
Hong Kong Standards and Testing Centre

Date : 2002-09-04

Page 2 of 2

NO: HC116483

METHOD(S) USED:

Ref. IEC 614-1 : 1994 Clause 13.4.5 and BS 4568 : Part 2 : 1970 (1988) :
Appendix A.3.3


TEST RESULT(S):

Number of specimen tested:	3 pieces
Number of specimen passed:	3 pieces
Number of specimen failed:	0 piece

SUMMARY

1. The submitted 25mm Distance Saddle (Hot-Dip Galvanized) complied with Clause 13.4.5 of IEC 614-1 : 1994 and BS 4568 : Part 2 : 1970 (1988) for Heavy Protection.
2. It also complied with the General Specification for Electrical Installation in Government Buildings of The Hong Kong Special Administrative Region (1998 Edition).

PHOTO OF SAMPLE:

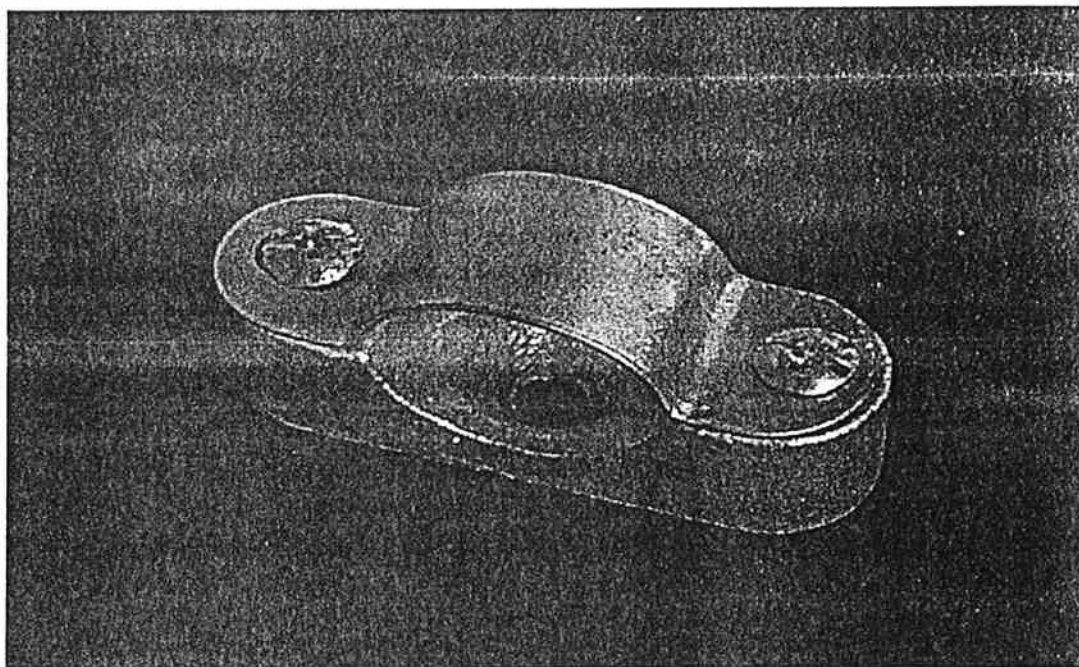

***** End of Document *****

Conditions in issuance of Test Report

1. This Report is issued in confidence to the client and it will be strictly treated as such by the Hong Kong Standards and Testing Centre Ltd. It may not be reproduced either in its entirety or in part and it may not be used for advertising. The client to whom the Report is issued may, however, show or send it, or a certified copy thereof, prepared by the Hong Kong Standards and Testing Centre Ltd. to his customer, supplier or other persons directly concerned. The Hong Kong Standards and Testing Centre Ltd. will not, without the consent of the client, enter into any discussion of correspondence with any third party concerning the contents of the Report. 2. The report refers only to the sample tested and does not apply to the bulk, unless the sampling has been carried out by the Hong Kong Standards and Testing Centre Ltd. and is stated as such in the Report. 3. In the event of the improper use of the report, the Hong Kong Standards and Testing Centre Ltd. reserves the rights to withdraw it, and to adopt any other remedial action which may be appropriate. 4. Sample submitted for testing are accepted on the understanding that the Report issued cannot

香港新界大埔工業邨大宏街10號
10 Dai Wang Street,
Taipo Industrial Estate,
N. T., Hong Kong
Tel : (852) 2666 1888



香港標準及檢定中心
Hong Kong Standards and Testing Centre

Date : 202-09-04

TEST REPORT

Page 1 of 2

NO: HC116484

APPLICANT: (Code: MAF002)

Many Folk Enterprises Limited
Flat F 13/F Golden Plaza
745-7 Nathan Rd
Kln

Attn: Mr Raymond Fung

DESCRIPTION OF SAMPLE(S):

One submitted sample said to be 32mm Distance Saddle (Hot-Dip Galvanized).
Item No. : HNSP32
Brand Name :



SAMPLE(S) RECEIVED DATE:

2002-08-19

TESTED DATE:

2002-08-28

INVESTIGATION(S) REQUESTED:

Test for resistance to corrosion – IEC 614-1 : 1994 : Clause 13.4.5 /
BS 4568 : Part 2 : 1970 (1988) Heavy Protection



Am
Anne Chuah, CFD
For Chief Executive

Conditions in issuance of Test Report

1. This Report is issued in confidence to the client and it will be strictly treated as such by the Hong Kong Standards and Testing Centre Ltd. It may not be reproduced either in its entirety or in part and it may not be used for advertising. The client to whom the Report is issued may, however, show or send it, or a certified copy thereof prepared by the Hong Kong Standards and Testing Centre Ltd. to his customer, supplier or other persons directly concerned. The Hong Kong Standards and Testing Centre Ltd. will not, without the consent of the client, enter into any discussion of correspondence with any third party concerning the contents of the Report. 2. The report refers only to the sample tested and does not apply to the bulk, unless the sampling has been carried out by the Hong Kong Standards and Testing Centre Ltd. and is stated as such in the Report. 3. In the event of the improper use of the report, the Hong Kong Standards and Testing Centre Ltd. reserves the rights to withdraw it, and to adopt any other remedies which may be appropriate. 4. Samples submitted for testing are accepted on the understanding that the Report issued cannot form the basis of, or be the instrument for, any legal action against the Hong Kong Standards and Testing Centre Ltd. 5. The Hong Kong Standards and Testing Centre Ltd. will not be liable for any loss or damage howsoever arising from the use of information contained in any of its Reports or in any communication whatsoever about its said tests or investigations. 6. Applicants wishing to use the Report in court proceedings or to refer to it shall inform the Hong

香港新界大埔工業邨大宏街10號
10 Dai Wang Street,
Taipo Industrial Estate,
N. T., Hong Kong
Tel : (852) 2666 1888
Fax : (852) 2664 4353
Homepage: www.hkstdc.com



香港標準及檢定中心

Hong Kong Standards and Testing Centre

Date : 2002-09-04

Page 2 of 2

NO: HC116484

METHOD(S) USED:

Ref. IEC 614-1 : 1994 Clause 13.4.5 and BS 4568 : Part 2 : 1970 (1988) :
Appendix A.3.3


TEST RESULT(S):

Number of specimen tested:	3 pieces
Number of specimen passed:	3 pieces
Number of specimen failed:	0 piece

SUMMARY

1. The submitted 32mm Distance Saddle (Hot-Dip Galvanized) complied with Clause 13.4.5 of IEC 614-1 : 1994 and BS 4568 : Part 2 : 1970 (1988) for Heavy Protection.
2. It also complied with the General Specification for Electrical Installation in Government Buildings of The Hong Kong Special Administrative Region (1998 Edition).

PHOTO OF SAMPLE:

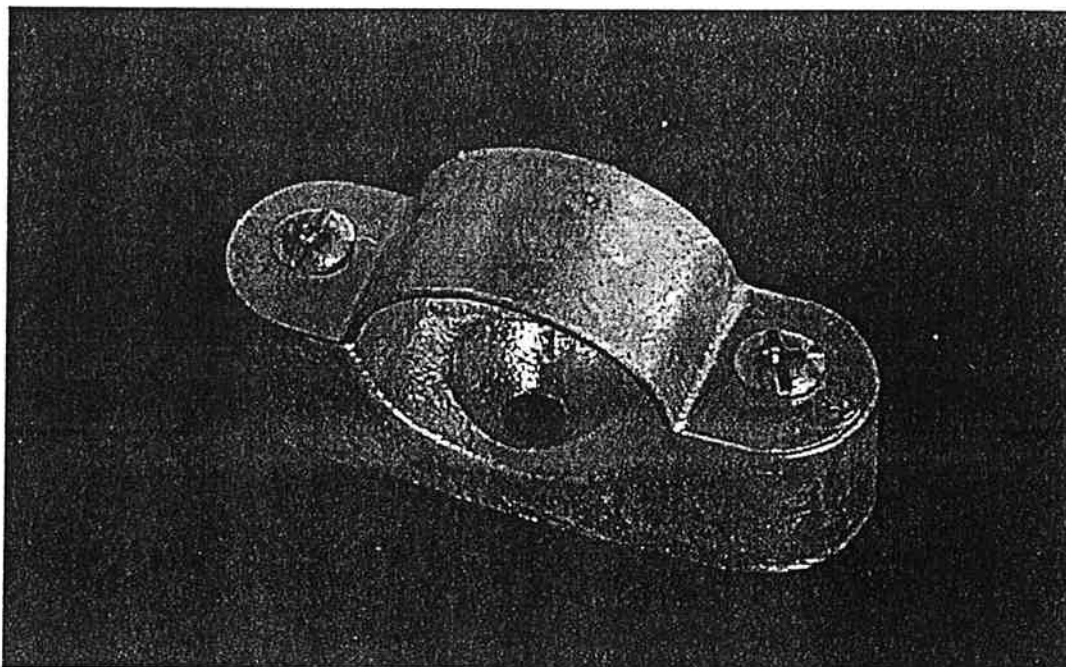

***** End of Document *****

Conditions in issuance of Test Report

1. This Report is issued in confidence to the client and it will be strictly treated as such by the Hong Kong Standards and Testing Centre Ltd. It may not be reproduced either in its entirety or in part and it may not be used for advertising. The client to whom the Report is issued may, however, show or send it, or a certified copy thereof prepared by the Hong Kong Standards and Testing Centre Ltd. to his customer, supplier or other persons directly concerned. The Hong Kong Standards and Testing Centre Ltd. will not, without the consent of the client, enter into any discussion of correspondence with any third party concerning the contents of the Report. 2. The report refers only to the sample tested and does not apply to the bulk, unless the sampling has been carried out by the Hong Kong Standards and Testing Centre Ltd. and is stated as such in the Report. 3. In the event of the improper use of the report, the Hong Kong Standards and Testing Centre Ltd. reserves the rights to withdraw it, and to adopt any other remedies which may be appropriate. 4. Samples submitted for testing are accepted on the understanding that the Report issued cannot form the basis of, or be the instrument for, any legal action against the Hong Kong Standards and Testing Centre Ltd. 5. The Hong Kong Standards and Testing Centre

香港新界大埔工業邨大宏街10號
10 Dai Wang Street,
Taipo Industrial Estate,
N. T., Hong Kong
Tel : (852) 2666 1888
Fax : (852) 2664 4353



香 港 標 準 及 檢 定 中 心

Hong Kong Standards and Testing Centre

Date : 2002-09-04

TEST REPORT

Page 1 of 2

NO: HC116486

APPLICANT: (Code: MAF002)

Many Folk Enterprises Limited
Flat F 13/F Golden Plaza
745-7 Nathan Rd
Kln

Attn: Mr Raymond Fung

DESCRIPTION OF SAMPLE(S):

One submitted sample said to be 20 x 6mm Hexagonal Locknut (Hot-Dip Galvanized).
Item No. : HNL184
Brand Name :



SAMPLE(S) RECEIVED DATE:

2002-08-19

TESTED DATE:

2002-08-28

INVESTIGATION(S) REQUESTED:

Test for resistance to corrosion – IEC 614-1 : 1994 : Clause 13.4.5 /
BS 4568 : Part 2 : 1970 (1988) Heavy Protection



Anne Chuah, CFD
For Chief Executive

Conditions in issuance of Test Report

1. This Report is issued in confidence to the client and it will be strictly treated as such by the Hong Kong Standards and Testing Centre Ltd. It may not be reproduced either in its entirety or in part and it may not be used for advertising. The client to whom the Report is issued may, however, show or send it, or a certified copy thereof prepared by the Hong Kong Standards and Testing Centre Ltd. to his customer, supplier or other persons directly concerned. The Hong Kong Standards and Testing Centre Ltd. will not, without the consent of the client, enter into any discussion of correspondence with any third party concerning the contents of the Report. 2. The report refers only to the sample tested and does not apply to the bulk, unless the sampling has been carried out by the Hong Kong Standards and Testing Centre Ltd. and is stated as such in the Report. 3. In the event of the improper use of the report, the Hong Kong Standards and Testing Centre Ltd. reserves the rights to withdraw it and to adopt any other remedies which may be appropriate. 4. Samples submitted for testing are accepted on the understanding that the Report issued cannot

香港新界大埔工業邨大宏街10號
10 Dai Wang Street,
Taipo Industrial Estate,
N. T., Hong Kong
Tel : (852) 2666 1888



香港標準及檢定中心
Hong Kong Standards and Testing Centre

Date : 2002-09-04

Page 2 of 2

NO: HC116486

METHOD(S) USED:

Ref. IEC 614-1 : 1994 Clause 13.4.5 and BS 4568 : Part 2 : 1970 (1988) :
Appendix A.3.3


TEST RESULT(S):

Number of specimen tested:	3 pieces
Number of specimen passed:	3 pieces
Number of specimen failed:	0 piece

SUMMARY

1. The submitted 20 x 6mm Hexagonal Locknut (Hot-Dip Galvanized) complied with Clause 13.4.5 of IEC 614-1 : 1994 and BS 4568 : Part 2 : 1970 (1988) for Heavy Protection.
2. It also complied with the General Specification for Electrical Installation in Government Buildings of The Hong Kong Special Administrative Region (1998 Edition).

PHOTO OF SAMPLE:

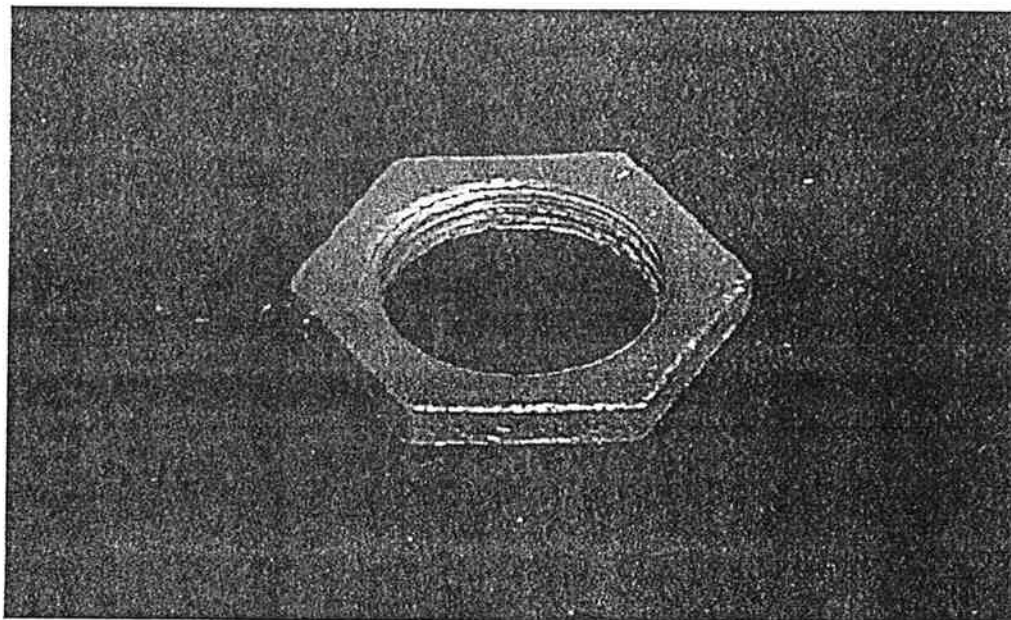

***** End of Document *****

Conditions in issuance of Test Report

1. This Report is issued in confidence to the client and it will be strictly treated as such by the Hong Kong Standards and Testing Centre Ltd. It may not be reproduced either in its entirety or in part and it may not be used for advertising. The client to whom the Report is issued may, however, show or send 1: or a certified copy thereof prepared by the Hong Kong Standards and Testing Centre Ltd. to his customer, supplier or other persons directly concerned. The Hong Kong Standards and Testing Centre Ltd. will not, without the consent of the client, enter into any discussion of correspondence with any third party concerning the contents of the Report. 2. The report refers only to the sample tested and does not apply to the bulk, unless the sampling has been carried out by the Hong Kong Standards and Testing Centre Ltd. and is stated as such in the Report. 3. In the event of the improper use of the report, the Hong Kong Standards and Testing Centre Ltd. reserves the rights to withdraw it, and to adopt any other remedies which may be appropriate. 4. Samples submitted for testing are accepted on the understanding that the Report issued cannot form the basis of, or be the instrument for, any legal action against the Hong Kong Standards and Testing Centre Ltd. 5. The Hong Kong Standards and Testing Centre

香港新界大埔工業邨大宏街10號
10 Dai Wang Street,
Taipo Industrial Estate,
N. T., Hong Kong
Tel : (852) 2666 1888
Fax : (852) 2664 4353



香港標準及檢定中心
Hong Kong Standards and Testing Centre

Date : 2002-09-04

TEST REPORT

Page 1 of 2

NO: HC116488

APPLICANT: (Code: MAF002)

Many Folk Enterprises Limited
Flat F 13/F Golden Plaza
745-7 Nathan Rd
Kln

Attn: Mr Raymond Fung

DESCRIPTION OF SAMPLE(S):

One submitted sample said to be 25 x 6mm Hexagonal Locknut (Hot-Dip Galvanized).
Item No. : HNL185
Brand Name :



SAMPLE(S) RECEIVED DATE:

2002-08-19

TESTED DATE:

2002-08-28

INVESTIGATION(S) REQUESTED:

Test for resistance to corrosion – IEC 614-1 : 1994 : Clause 13.4.5 /
BS 4568 : Part 2 : 1970 (1988) Heavy Protection


Anne Chuah, CHES
For Chief Executive



Conditions in issuance of Test Report

1. This Report is issued in confidence to the client and it will be strictly treated as such by the Hong Kong Standards and Testing Centre Ltd. It may not be reproduced either in its entirety or in part and it may not be used for advertising. The client to whom the Report is issued may, however, show or send it, or a certified copy thereof prepared by the Hong Kong Standards and Testing Centre Ltd. to his customer, supplier or other persons directly concerned. The Hong Kong Standards and Testing Centre Ltd. will not, without the consent of the client, enter into any discussion of correspondence with any third party concerning the contents of the Report. 2. The report refers only to the sample tested and does not apply to the bulk, unless the sampling has been carried out by the Hong Kong Standards and Testing Centre Ltd. and is stated as such in the Report. 3. In the event of the improper use of the report, the Hong Kong Standards and Testing Centre Ltd. reserves the rights to withdraw it, and to adopt any other remedies which may be appropriate. 4. Samples submitted for testing are accepted on the understanding that the Report issued cannot form the basis of, or be the instrument for, any legal action against the Hong Kong Standards and Testing Centre Ltd. 5. The Hong Kong Standards and Testing Centre Ltd. will not be liable for or accept responsibility for any loss or damage howsoever arising from the use of information contained in any of its Reports or in any

香港新界大埔工業邨大宏街10號
10 Dai Wang Street,
Taipo Industrial Estate,
N. T., Hong Kong
Tel : (852) 2666 1888
Fax : (852) 2664 4353
www.hkstdc.org.hk



香 港 標 準 及 檢 定 中 心

Hong Kong Standards and Testing Centre

Date : 2002-09-04

Page 2 of 2

NO: HC116488

METHOD(S) USED:

Ref. IEC 614-1 : 1994 Clause 13.4.5 and BS 4568 : Part 2 : 1970 (1988) :
Appendix A.3.3


TEST RESULT(S):

Number of specimen tested:	3 pieces
Number of specimen passed:	3 pieces
Number of specimen failed:	0 piece

SUMMARY

1. The submitted 25 x 6mm Hexagonal Locknut (Hot-Dip Galvanized) complied with Clause 13.4.5 of IEC 614-1 : 1994 and BS 4568 : Part 2 : 1970 (1988) for Heavy Protection.
2. It also complied with the General Specification for Electrical Installation in Government Buildings of The Hong Kong Special Administrative Region (1998 Edition).

PHOTO OF SAMPLE:

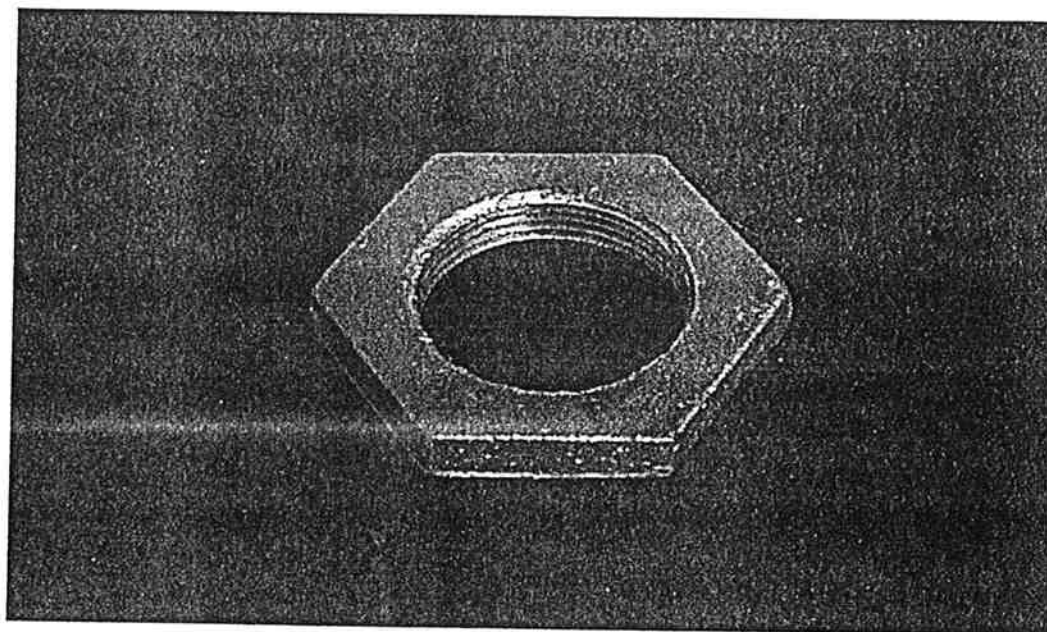

***** End of Document *****

Conditions in issuance of Test Report

1. This Report is issued in confidence to the client and it will be strictly treated as such by the Hong Kong Standards and Testing Centre Ltd. It may not be reproduced either in its entirety or in part and it may not be used for advertising. The client to whom the Report is issued may, however, show or send it, or a certified copy thereof prepared by the Hong Kong Standards and Testing Centre Ltd. to his customer, supplier or other persons directly concerned. The Hong Kong Standards and Testing Centre Ltd. will not, without the consent of the client, enter into any discussion of correspondence with any third party concerning the contents of the Report. 2. The report refers only to the sample tested and does not apply to the bulk, unless the sampling has been carried out by the Hong Kong Standards and Testing Centre Ltd. and is stated as such in the Report. 3. In the event of the improper use of the report, the Hong Kong Standards and Testing Centre Ltd. reserves the rights to withdraw it, and to adopt any other remedies which may be appropriate. 4. Samples submitted for testing are accepted on the understanding that the Report issued cannot form the basis of, or be the instrument for, any legal action against the Hong Kong Standards and Testing Centre Ltd. 5. The Hong Kong Standards and Testing Centre Ltd.

香港新界大埔工業邨大宏街10號
10 Dai Wang Street,
Taipo Industrial Estate,
N. T., Hong Kong
Tel : (852) 2666 1888
Fax : (852) 2664 4353



香港標準及檢定中心

Hong Kong Standards and Testing Centre

Date : 2002-09-04

TEST REPORT

Page 1 of 2

NO: HC116489

APPLICANT: (Code: MAF002)

Many Folk Enterprises Limited
Flat F 13/F Golden Plaza
745-7 Nathan Rd
Kln

Attn: Mr Raymond Fung

DESCRIPTION OF SAMPLE(S):

One submitted sample said to be 32 x 6mm Hexagonal Locknut (Hot-Dip Galvanized).
Item No. : HNL186
Brand Name :



SAMPLE(S) RECEIVED DATE:

2002-08-19

TESTED DATE:

2002-08-28

INVESTIGATION(S) REQUESTED:

Test for resistance to corrosion – IEC 614-1 : 1994 : Clause 13.4.5 /
BS 4568 : Part 2 : 1970 (1988) Heavy Protection

Anne Chuah, CFD
For Chief Executive



Conditions in Issuance of Test Report

1. This Report is issued in confidence to the client and it will be strictly treated as such by the Hong Kong Standards and Testing Centre Ltd. It may not be reproduced either in its entirety or in part and it may not be used for advertising. The client to whom the Report is issued may, however, show or send it, or a certified copy thereof prepared by the Hong Kong Standards and Testing Centre Ltd. to his customer, supplier or other persons directly concerned. The Hong Kong Standards and Testing Centre Ltd. will not, without the consent of the client, enter into any discussion of correspondence with any third party concerning the contents of the Report. 2. The report refers only to the sample tested and does not apply to the bulk, unless the sampling has been carried out by the Hong Kong Standards and Testing Centre Ltd. and is stated as such in the Report. 3. In the event of the improper use of the report, the Hong Kong Standards and Testing Centre Ltd. reserves the rights to withdraw it, and to adopt any other remedies which may be appropriate. 4. Samples submitted for testing are accepted on the understanding that the Report issued cannot

香港新界大埔工業邨大宏街10號
10 Dai Wang Street,
Taipo Industrial Estate,
N. T., Hong Kong
Tel : (852) 2666 1888



香港標準及檢定中心

Hong Kong Standards and Testing Centre

Date : 2002-09-04

Page 2 of 2

NO: HC116489

METHOD(S) USED:

Ref. IEC 614-1 : 1994 Clause 13.4.5 and BS 4568 : Part 2 : 1970 (1988) :
Appendix A.3.3


TEST RESULT(S):

Number of specimen tested:	3 pieces
Number of specimen passed:	3 pieces
Number of specimen failed:	0 piece

SUMMARY

1. The submitted 32 x 6mm Hexagonal Locknut (Hot-Dip Galvanized) complied with Clause 13.4.5 of IEC 614-1 : 1994 and BS 4568 : Part 2 : 1970 (1988) for Heavy Protection.
2. It also complied with the General Specification for Electrical Installation in Government Buildings of The Hong Kong Special Administrative Region (1998 Edition).

PHOTO OF SAMPLE:

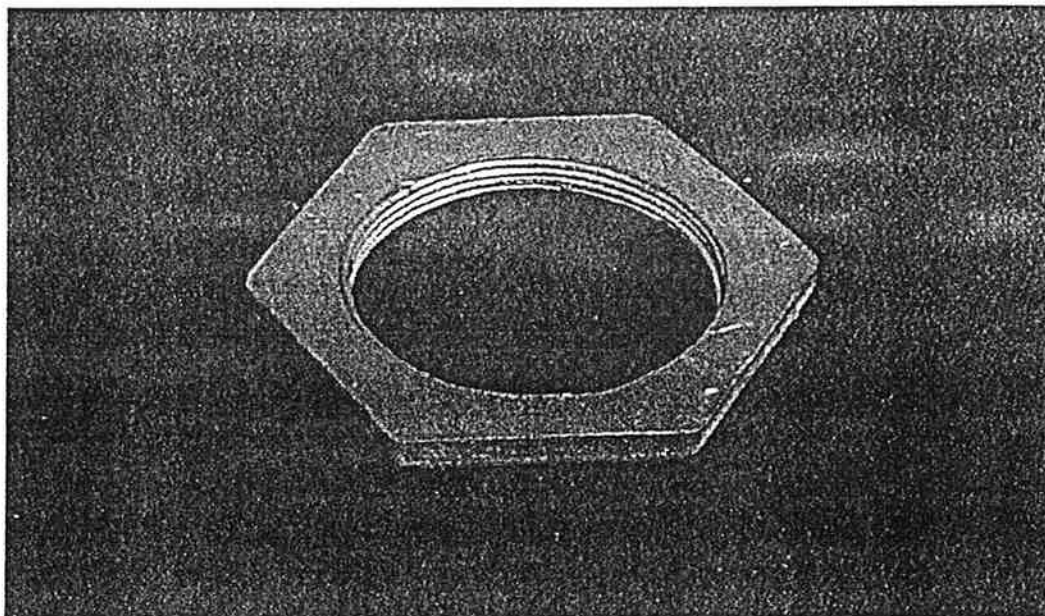

***** End of Document *****

Conditions in issuance of Test Report

1. This Report is issued in confidence to the client and it shall be strictly treated as such by the Hong Kong Standards and Testing Centre Ltd. It may not be reproduced either in its entirety or in part and it may not be used for advertising. The client to whom the Report is issued may, however, show or send it, or a certified copy thereof prepared by the Hong Kong Standards and Testing Centre Ltd. to his customer, supplier or other persons directly concerned. The Hong Kong Standards and Testing Centre Ltd. will not, without the consent of the client, enter into any discussion of correspondence with any third party concerning the contents of the Report. 2. The report refers only to the sample tested and does not apply to the bulk, unless the sampling has been carried out by the Hong Kong Standards and Testing Centre Ltd. and is stated as such in the Report. 3. In the event of the improper use of the report, the Hong Kong Standards and Testing Centre Ltd. reserves the rights to withdraw it, and to adopt any other remedies which may be appropriate. 4. Samples submitted for testing are accepted on the understanding that the Report issued cannot form the basis of, or be the instrument for, any agreement between the Hong Kong Standards and Testing Centre Ltd. 5. The Hong Kong Standards and Testing Centre Ltd. will not be liable for or accept responsibility for any loss or damage whatsoever arising from the use of information contained in any of its Reports or in any

香港新界大埔工業邨大宏街10號
10 Dai Wang Street,
Taipo Industrial Estate,
N. T., Hong Kong
Tel : (852) 2666 1888
Fax : (852) 2664 4353
Homepage: www.hkstdc.com